




DISCLAIMER: The use of this standard is governed by the City of Wichita Falls Engineering Department. No warranty of any kind is made by the City of Wichita Falls for any purpose whatsoever. The City of Wichita Falls assumes no responsibility for the conversion of this standard to other formats for incorrect results or damages resulting from its use.

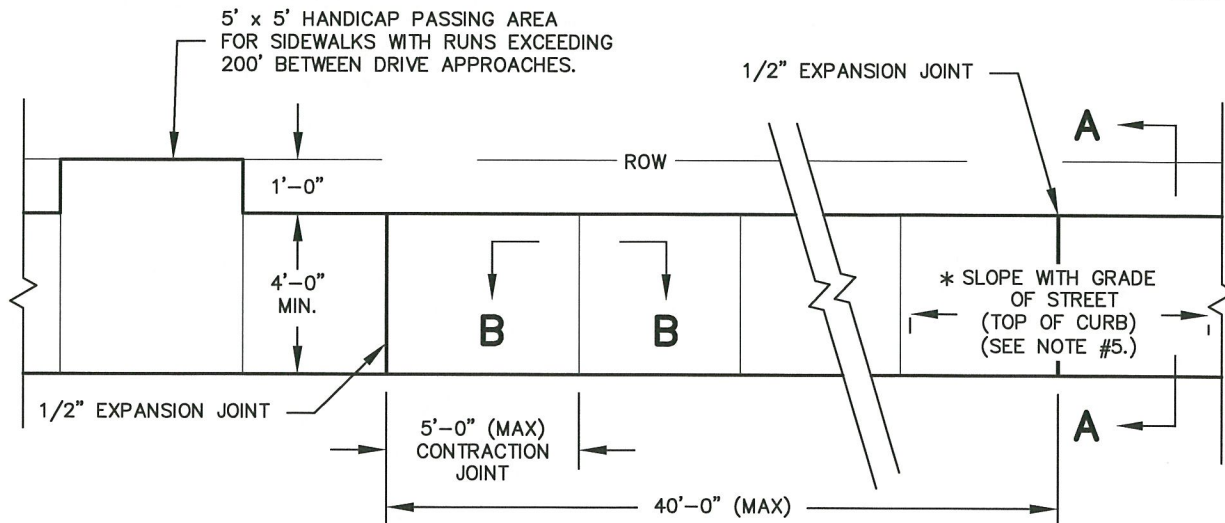

**PLAN**  
NOT TO SCALE

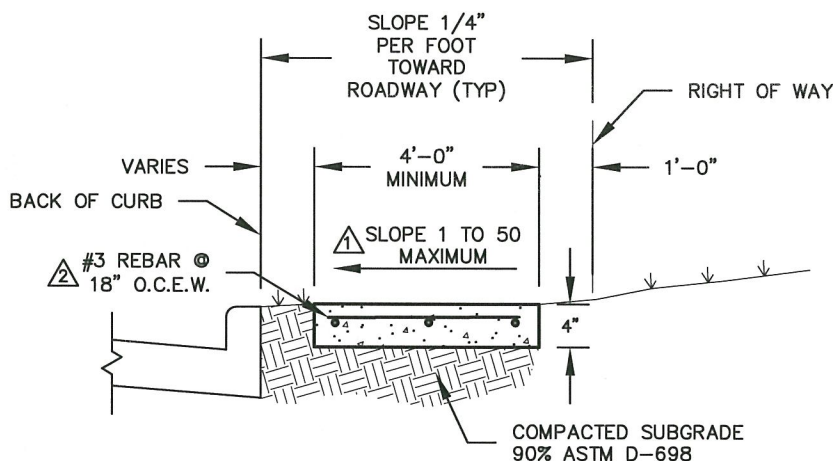

**SECTION A-A**  
NOT TO SCALE

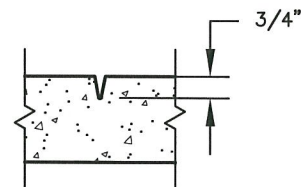

**SECTION B-B**  
**CONTRACTION JOINT**  
NOT TO SCALE

**GENERAL NOTES:**

1. SIDEWALK REINFORCING (EXCLUDING DRIVE APPROACHES) SHALL BE #3 BARS @ 18" O.C.E.W.
2. ALL CONCRETE SHALL BE CLASS A, 5 SACK.
3. SAND SHALL NOT BE ACCEPTED AS COMPACTED SUBGRADE. SAND WILL BE ALLOWED FOR LEVEL-UP ONLY.
4. ANY UTILITY BOXES OR MANHOLES WITHIN THE SIDEWALK OR APPROACH MUST BE ADJUSTED BY THE CITY UTILITY DEPARTMENT TO THE GRADE SHOWN. ALL ADJUSTMENT COST WILL BE THE RESPONSIBILITY OF THE CONTRACTOR, OR AS DIRECTED BY THE CITY ENGINEER.
5. SLOPE AT DRIVE APPROACHES AND APPROACHING RAMPS MUST COMPLY WITH ADA REQUIREMENTS. (1 INCH PER FOOT MAXIMUM)



**SIDEWALK**  
ACAD DRAWING NAME

OCT 08

DATE DRAWN

2130-00

STANDARD DRAWING NO.

CITY OF WICHITA FALLS, TX

**SIDEWALK STANDARD**



10/08

ADD REBAR

JCC



03/05

SLOPE CHANGE

DJB

NO.

DATE

DESCRIPTION

BY

R

E

V

I

S

I

O

N

S

APPROVED

*Russell Schmitz*  
CITY ENGINEER

OCT 2008

DATE